

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400


TEST REPORT

Client : Fairview Architectural Pty Ltd
18-20 Donald Street
Lithgow NSW 2790

Test Number : 24-001365
Issue Date : 17/04/2024
Print Date : 10/07/2024

Sample Description

Clients Ref : "Vitrafix Wall Sarking"
Three layer non woven breathable membrane
Colour : Green/White
End Use : Breathable membrane for use on external facades
Nominal Composition : Polyethylene
Nominal Mass per Unit Area/Density : 115g/m2
Nominal Thickness : 0.5mm

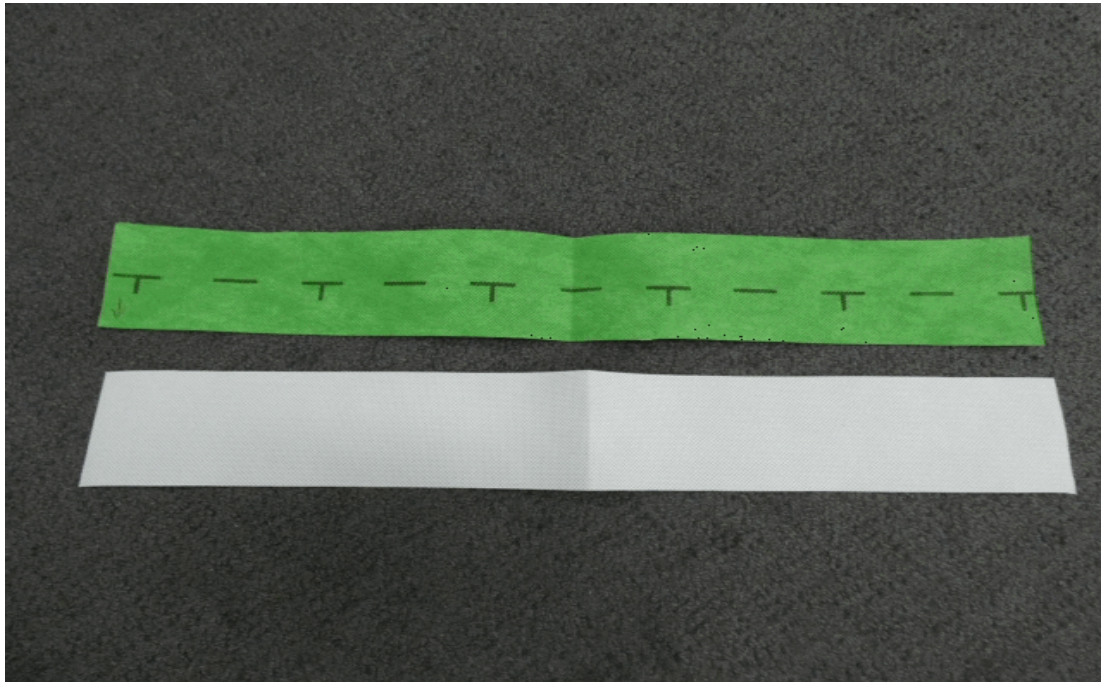

325933

70216

Page 1 of 2

© Australian Wool Testing Authority Ltd
Copyright - All Rights Reserved




Accredited for compliance with ISO/IEC 17025 - Testing
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Fiona McDonald

APPROVED SIGNATORY



MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400

TEST REPORT

Client : Fairview Architectural Pty Ltd
18-20 Donald Street
Lithgow NSW 2790

Test Number : 24-001365
Issue Date : 17/04/2024
Print Date : 10/07/2024

AS 1530.2-1993

Methods for Fire Tests on Building Materials, Components and Structures. Part 2: Test for Flammability of Materials

Date Tested	16-04-2024	
Flammability Index	1	
	Length	Width
Spread Factor	0	0
Heat Factor	1	1
Maximum height (d)		
Mean	2.4	2.1
Coefficient of Variation	98.6	71.4 %
Heat (a)		
Mean	1.6	1.5 °C.min
Coefficient of Variation	13.7	0.0 %
Number of Specimens Tested	9	9
Visibile smoke, melting and dripping		
Compliance to AS/NZS 4200.1-2017 Clause 5.3.6	Low	

These test results relate only to the behaviour of the test specimens of the material under the particular conditions of the test, and they are not intended to be the sole criterion for assessing the potential fire hazard of the material in use.

325933

70216

Page 2 of 2

© Australian Wool Testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR